

HYDRAULIC TURBOMACHINES

Exercises 3 - Cavitation

Setting level of a Francis turbine

In Figure 1, the installation of the turbine and setting level are shown. Consider the following input data:

$$C_T = 0.86 \text{ m} \cdot \text{s}^{-1}$$

$$Z_B = 175.6 \text{ m}$$

$$\rho_{atm} = 1.0 \text{ bar}$$

$$\rho_v = 2343 \text{ Pa}$$

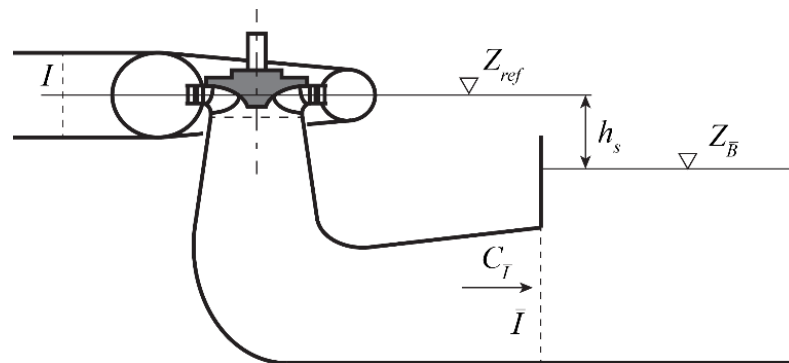


Figure 1. Machine setting level

- 1) Express the Net Positive Suction Specific Energy (*NPSE*) by gH_T , Z_{ref} , and a saturated pressure p_v .
- 2) Express Thoma number σ defined by $\frac{NPSE}{E}$, using the setting level $h_s = Z_{ref} - Z_B$, the flow velocity C_T , the saturated pressure p_v and the atmosphere pressure p_a . Assume that the draft tube outlet is considered as a water outflow ($K_v = 1$).
- 3) Compute Z_{ref} , the setting elevation of the turbine units, to achieve a Net Positive Suction Head (NPSH) of 13.4 m.