

HYDRAULIC TURBOMACHINES

Mock exam – part 2

Duration : 2 hours;

Documentation: personal hand written notes, bilingual dictionary, and available lectures and exercises on the Moodle are authorized; you can use your laptop in offline mode (no internet connection).

Exam evaluation: The weight of each question is indicated. General presentation and clarity of answers will be taken into account for the evaluation.

Maximum total score: 30 points

Pumped storage power plant

The outline of a pumped storage power plant is shown in Figure 1. The power plant features 2 units, each one equipped with a pump-turbine. Answer to the questions based on the values provided in Table 1. The gravity acceleration, the water density and water kinematic viscosity are $g = 9.81 \text{ m s}^{-2}$, $\rho = 998 \text{ kg m}^{-3}$ and $\nu_{\text{water}} = 10^{-6} \text{ m}^2 \text{ s}^{-1}$. In Table 1, the main operating parameters of the power plant are listed.

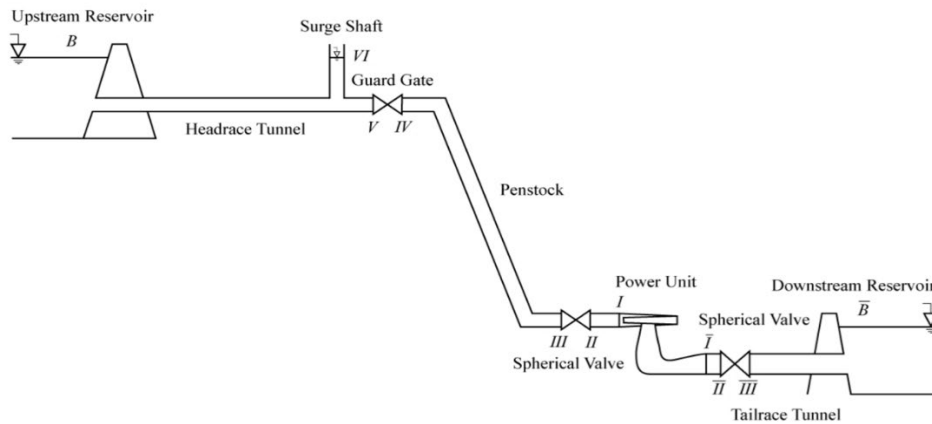


Figure 1 – Outline of the power station

Table 1 – Fixed parameters of the power plant

Data	Symbol	Value	Unit
Atmospheric pressure	p_a	1×10^5	Pa
Saturated vapor pressure	p_v	2343	Pa
Headwater reservoir level	Z_B	1250	m
Tailwater reservoir level	$Z_{\bar{B}}$	1025	m
Amount of units in the power plant	z_{machines}	2	-
Number of poles pairs	$z_{p, \text{pairs}}$	10	-

Frequency of the grid	f_{grid}	50	Hz
Inlet (in turbine mode) section diameter	D_{1e}	3.50	m
Inlet (in turbine mode) section height	B	0.60	m
Outlet (in turbine mode) section diameter	D_{1e}	2.80	m

Pumped storage power plant – turbine mode

Table 2 – Turbine mode parameters of the power unit

Energetic efficiency	η_e	0.92	-
Volumetric efficiency	η_q	0.99	-
Global machine efficiency	η	0.90	-
Rated discharge per unit	Q	50	m^3s^{-1}

At first, we consider the power plant in generating mode. The operation parameters are listed in Table 2.

- 1 Compute the specific potential energy of the installation. [1 point]
- 2 For the rated discharge, the head losses of the installation have been measured and are equal to $\sum gH_r = 201.4 \text{ J kg}^{-1}$. Compute the available specific energy of the turbines. Deduce the net head H of the turbines.
- 3 Compute the runner frequency n (Hz) and the specific speed v of the runner. [1 point]
- 4 Compute P_h , the hydraulic power. [1 point]
- 5 Compute the transferred specific energy E_t . [1 point]
- 6 Compute the torque experienced by the runner shaft T_t . [1 point]
- 7 Compute the mechanical efficiency ($\eta_{me} = \eta_{rm} \cdot \eta_m$). [1 point]
- 8 Express the Net Positive Suction Specific Energy (NPSE) by gH_T , the machine altitude level Z_{ref} , and the saturated pressure p_v . [1 point]
- 9 Express Thoma number $\sigma = \frac{NPSE}{E}$, using the setting level $h_s = Z_{ref} - Z_B$, the flow velocity C_T , the available specific energy E , the saturated pressure p_v and the atmospheric pressure p_a . Neglect singular and regular losses inside the tailrace tunnel, and assume that the tailrace tunnel outlet behaves as a water outflow (i.e. a sudden exit). [2 point]
- 10 Assuming a draft tube outlet section of 25 m^2 , compute the required Z_{ref} to achieve a Net Positive Suction Head (NPSH) of 11.9 m. [2 point]

Pumped storage power plant – pump mode

Table 3 – Pump mode parameters of the power unit

Energetic efficiency	η_e	0.92	-
Volumetric efficiency	η_q	0.99	-
Global machine efficiency	η	0.90	-
Rated discharge per unit	Q	48	m^3s^{-1}

Let's now move to study the power plant in pumping mode. The operation parameters are listed in Table 3. For this operating condition, it is assumed that the inlet velocity \vec{C}_T is axial and uniformly distributed. The outlet flow is also radially uniform. All the flow distribution coefficients k_{cu} and k_{cm} of global Euler equation, are then assumed equal to 1.

- 11 Compute the meridional component of the inlet absolute velocity Cm_{T_e} . [1 point]
- 12 Compute the inlet tangential velocity U_{T_e} and the relative inlet flow angle β_{T_e} . [1 point]
- 13 The hydraulic power in pump mode for this power plant corresponds to the 97% of the hydraulic power in turbine mode. Compute the specific energy. [2 point]
- 14 Compute the transferred specific energy. [1 point]
- 15 Compute the outlet tangential velocity U_{1e} and the tangential component of the absolute outlet velocity Cu_{1e} . [1.5 point]
- 16 Is this operating condition the one corresponding to the maximum power transfer condition? Justify your answer. [1.5 point]
- 17 Assume an outlet blade angle $\beta_{1b} = 24^\circ$ and no-slip condition fulfilled. For the same machine rotating velocity and the same efficiencies as listed in Table 3, provide the values of discharge Q and net head H that would allow the machine to operate in its maximum power transfer. [2.5 point]

Now imagine that you are in charge of testing the reduced scale model of this pump-turbine in pumping mode, with a scale ratio $\lambda_{scale} = 4.80$. To ensure that the results you get from the tests are reliably representing the behavior of the real scale machine, you must correctly determine several operational parameters. To do that, consider the rated operating condition (and not the optimum computed in question 18). The subscript M indicates a quantity at Model scale, whereas the subscript P indicates the real scale machine (i.e. the Prototype scale).

- 18 Compute the different IEC Factors for speed, discharge, torque and power, considering 1% of bearing power losses. Use D_{1e} as the reference diameter. [2 point]

- 19 Compute the pump inlet and outlet diameters of the reduced scale model $D_{\bar{1}e,M}$ and $D_{1e,M}$. [2 point]
- 20 Determine the net head at reduced model scale H_M considering similarity of the Froude number between real scale and model scale. [1.5 point]
- 21 Considering similarity of the IEC factors, compute the model scale rotational speed ω_M , discharge Q_M and mechanical torque $T_{m,M}$. [2 point]